

Powerlock Termination Guide

Contents Index

1. OVERVIEW	2
2. TERMINATION METHODS.....	3
2.1 CRIMP TERMINATION	3
2.1.1 Crimp Connector Components.....	3
2.1.2 Crimp Die	4
2.1.3 Crimp Tool.....	4
2.1.4 Crimp Assembly Tools	4
2.1.5 Double Crimp Arrangement	5
2.1.6 Recommended Assembly Procedure.....	6
2.2 SET SCREW TERMINATION	7
2.2.1 Set Screw Connector Components.....	7
2.2.2 Recommended Assembly Procedure.....	8
2.3 PANEL MOUNT TERMINATION.....	9
2.3.1 Panel Mount Connector Components.....	9
2.3.2 Recommended Assembly Procedure.....	10
3. TERMINATION TEST DATA.....	10
4. HYDRAULIC CRIMP TOOL SUPPLIERS.....	10
5. GENERAL	11
5.1 Maintenance	11
5.2 Application	11
5.3 Handling.....	11
6. DISCLOSURE STATEMENT	11
7. CONTACT DETAILS	11
8. HOW TO ORDER.....	12

Figure List

Figure 1. Line Drain Crimped Connector.....	3
Figure 2. Line Source Crimped Connector.....	3
Figure 3. Crimp Die Dimensions	4
Figure 4. Example Of A Typical Hydraulic Crimp Tool With Dies	5
Figure 5. Recommended Double Crimp Arrangement.....	5
Figure 6. Inspection Hole In Contact	6
Figure 7. Example Of Crimp Operation	6
Figure 8. Line Drain Set Screw Connector.....	7
Figure 9. Line Source Set Screw Connector	7
Figure 10. Showing Cable Stripped Alongside Reduction Sleeve	8
Figure 11. Showing Reduction Sleeve Fitted	8
Figure 12. Showing Contact With Set Screws Fitted Over Cable And Reduction Sleeves	8
Figure 13. Panel Type Connector	10

Table List

Table 1. Crimping Die And Tool Data.....	4
Table 2. Set Screw Assembly Data.....	9

1. OVERVIEW

Due to the wide range of cables used in the market, to ensure that a satisfactory result is obtained when Powerlock connectors are terminated onto the end of the cables, the type and method used needs to be evaluated.

This guide is intended to provide details of how to successfully terminate cables into Powerlock connectors, either by crimping, set screws or threaded post methods.

This document provides guidelines on:

- How to perform a crimped termination.
- What type of crimp tools and dies to use with recommendations.
- How to perform a set screw termination.
- Terminating a threaded post panel type connector.
- Typical test results obtained when terminating connectors onto a range of cables.
- It is important that this specification is followed, as incorrectly crimp cables are a Safety Hazard.

2. TERMINATION METHODS

Powerlock connectors can be terminated to cables by using one of the following methods:

- Crimp termination.
- Set screw termination.
- Threaded post termination.

These recommended assembly methods are detailed below. If in doubt, consult ITT. A separate test report (Report No. 1392) shows details of the test data currently available.

2.1 CRIMP TERMINATION

It is essential to use the recommended crimp tool and die to ensure a satisfactory crimp. It is important that you are satisfied that the crimped joint meets your requirements. Consult ITT for details on pull off loads and mV drop values expected.

2.1.1 Crimp Connector Components

Shown below in figures 1 and 2 are the components supplied for both line drain and line source connectors. Both connector types include the following;

- Cable Gland
- Contact
- Insulator
- Cotter Pin

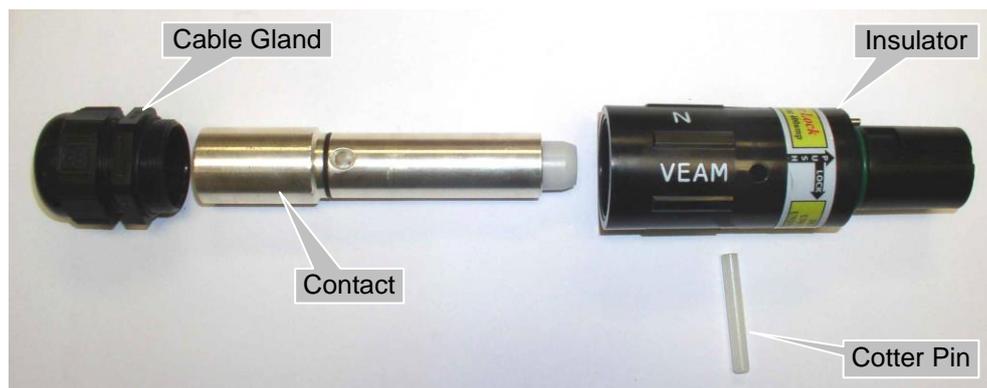


Figure 1. Line Drain Crimped Connector

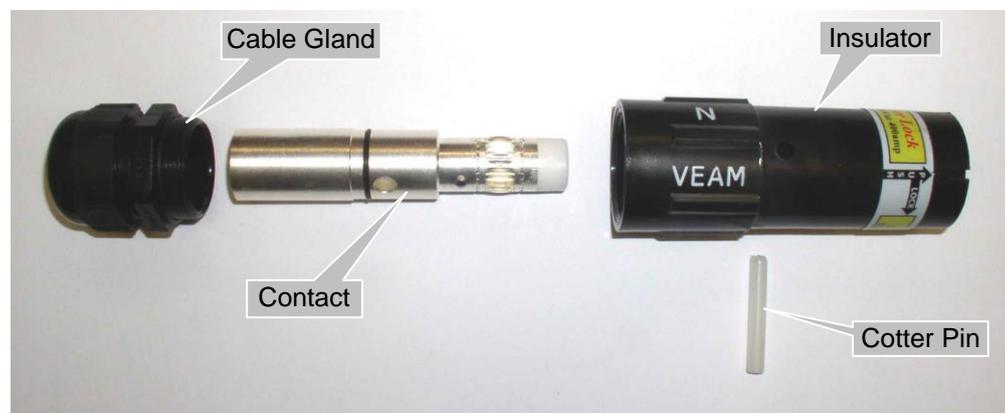


Figure 2. Line Source Crimped Connector

2.1.2 Crimp Die

The crimp die type and size are one of the most important aspects of the crimping operation to achieve a satisfactory crimped joint.

They vary depending on the actual cable / contact combination to be crimped.

A hexagon type crimp is recommended by ITT.

The main variables are the across flats dimension and the die width.

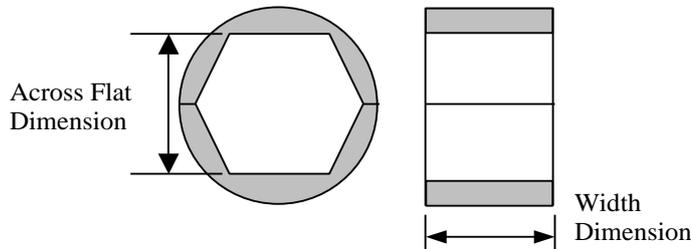


Figure 3. Crimp Die Dimensions

2.1.3 Crimp Tool

Depending on the application, various crimp tool and die set combinations can be used.

Listed in Table 1 below is the crimping die and tool data currently available for use by ITT.

Supplier	Crimp Tool Type	Crimp Die Type	Description	Crimp Die Details	
				Die Across Flat Dimension (mm)	Die Width Dimension (mm)
ITT	C130	30220	C25	7.6	9.0
		30221	C35	9.0	12.0
		30222	C50	10.0	12.0
		30223	C70	12.0	12.0
		30224	C95	14.0	12.0
		30235	C120	16.0	12.0
		30236	C150	17.3	12.0
		30237	C185	19.0	12.0
		30227	C240	23.57	12.0
		30228	C240NEW	21.5	12.0
		30229	C300	23.0	12.0
Kompress	KHH	13C-300	C240	24.3mm	15.0

Table 1. Crimping Die And Tool Data

2.1.4 Crimp Assembly Tools

The tools listed below are recommended:

Cable Stripper

Soft hammer/Press

Strap Wrench

Crimping Tool - ITT or Kompress (See end of document for tool suppliers)

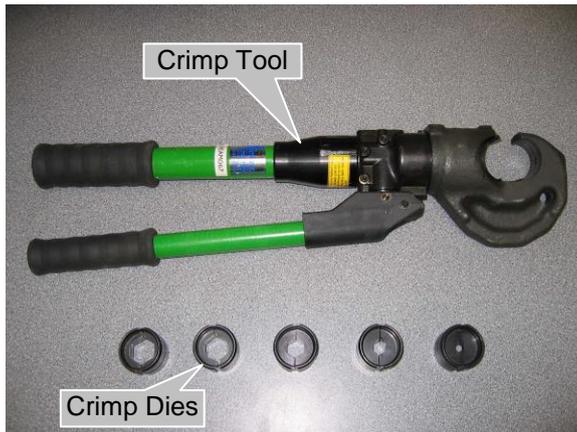


Figure 4. Example Of A Typical Hydraulic Crimp Tool With Dies

2.1.5 Double Crimp Arrangement

The default recommended method is to double crimp although single crimps may be suitable for crimping smaller cables. See the test data attached for information. Each crimp should be at 90° to each other and positioned centrally within the contact crimp area, as shown in Figure 5 below. If a single crimp is used, the crimp should be positioned centrally within the 35mm area shown in figure 5 below. Crimp in the order shown to ensure a satisfactory crimp. Consult the factory if any additional information or advice is required.

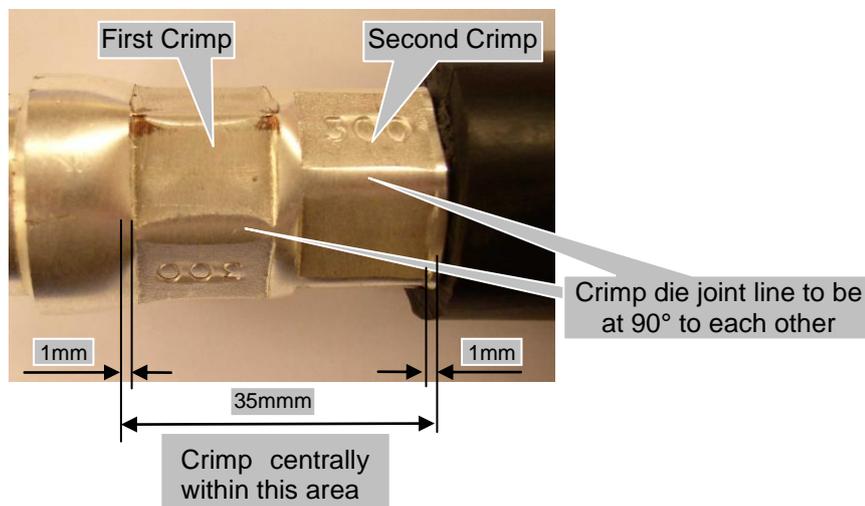


Figure 5. Recommended Double Crimp Arrangement

2.1.6 Recommended Assembly Procedure

1. Remove the Cable Gland from the Insulator and remove the contact.
2. Slide the Cable Gland onto the cable being terminated.
3. Carefully strip back the cable insulation by 42mm taking care not to damage any of the conductor stranding.

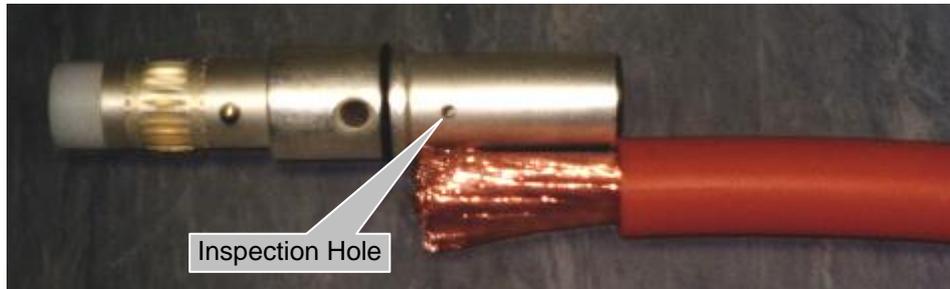


Figure 6. Inspection Hole In Contact

4. Insert the conductor stranding into the crimp bucket at the rear of the contact. Ensure that the cable is straight within a distance of 1 metre of the crimping location. This ensures that the individual cable wire strands are not distorted or displaced to each other caused by bending the cable.

With the crimping tool, crimp the contact twice (as shown in figure 6) making sure that the cable is being forced into the contact and ensuring that the cable conductor is visible through the inspection hole.

5. Examine the crimped joint to ensure that the crimp is satisfactory. Ensure that all of the conductor strands are contained within the crimped area.
6. Following the crimping operation, any contact material deformed between the crimp dies which prevents the contact assembly from being fitted into the Insulator assembly should be removed, in line with normal working practices.



Figure 7. Example Of Crimp Operation

7. Fit the crimped contact into the insulator and visually align the cotter pin holes.

8. Fit the cotter pin, tapered end first into the insulator/contact using either a press or a soft hammer.

Note that the cotter pin should only be used once. Re-using the cotter pin will invalidate the IP67 rating.

9. Ensure that the cotter pin is visible from both sides of the assembly after fitting and is flush/sub flush with the insulator.

10. Screw the cable gland into the insulator, tightening to a torque of 11Nm Maximum.

11. Finally inspect overall assembly.

2.2 SET SCREW TERMINATION

It is essential to use the recommended assembly method, reduction sleeves and set screw tightening torques to ensure a satisfactory termination.

2.2.1 Set Screw Connector Components

Show below in figures 8 and 9 are the components supplied for both line drain and line source connectors. Both connector types include the following;

- Cable Gland
- Contact
- Insulator
- Cotter Pin
- Reduction Sleeves

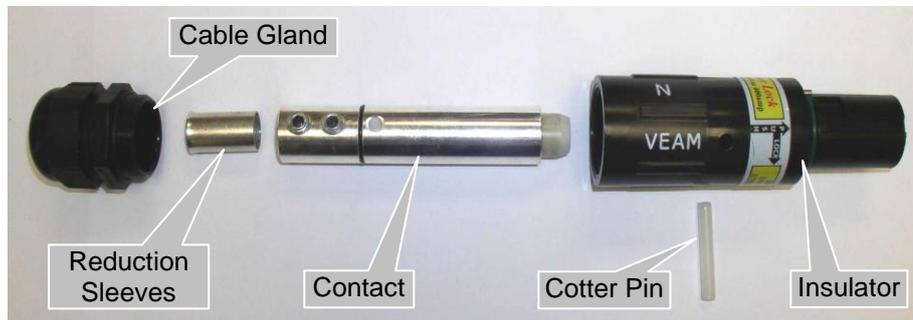


Figure 8. Line Drain Set Screw Connector

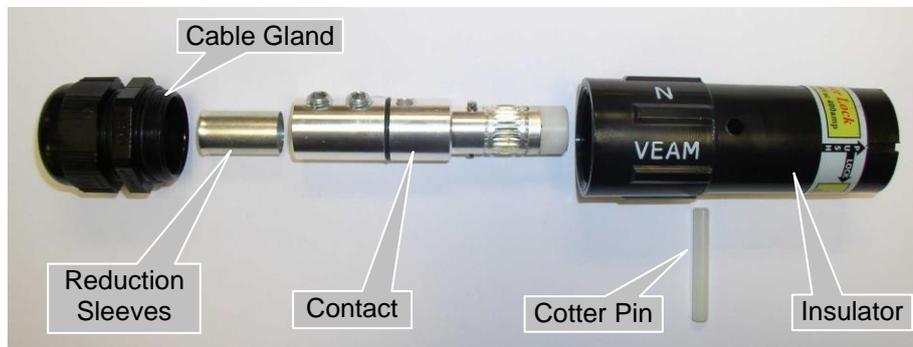


Figure 9. Line Source Set Screw Connector

2.2.2 Recommended Assembly Procedure

1. Remove the Cable Gland from the insulator and take out the contact.
2. Slide the Cable Gland onto the cable being terminated.
3. Carefully strip back the cable insulation by ~33mm taking care not to damage any of the conductor stranding.



Figure 10. Showing Cable Stripped Alongside Reduction Sleeve

4. Select the appropriate reduction sleeves (see table 2 below) and slide on in sequence over the exposed conductor stranding.

All sleeves down to the size recommended for the cable in use should be used:
i.e. for the 35mm² cable, the R120, R95, R70, R50 and R35 sleeves should all be used.

The sleeves fit inside each other to give a gradual reduction in diameter.
The flared end of the sleeves should be against the cable insulation.



Figure 11. Showing Reduction Sleeve Fitted

5. Slide the cable and reduction sleeves into the rear of the contact ensuring that they are fully seated inside of the contact.

Using a 5mm A/F Allen key tighten the set screws to the appropriate torque setting (see table 2 below).



Figure 12. Showing Contact With Set Screws Fitted Over Cable And Reduction Sleeves

Cable Size (mm ²)	Reduction Sleeve Required	Set Screw Torque Minimum (Nm)	Cable Jacket Strip Length (mm)
25mm ²	R120...R25	10.5	33
35mm ²	R120...R35	10.5	33
50mm ²	R120...R50	10.5	33
70mm ²	R120...R70	10.5	33
95mm ²	R120 + R95	10.5	33
120mm ²	R120	10.5	33

Table 2. Set Screw Assembly Data

6. Fit the contact into the front insulator and visually align the cotter pin holes.
7. Fit the cotter pin, tapered end first into the insulator/contact using either a press or a soft hammer.

Note that the cotter pin should only be used once. Re-using the cotter pin can invalidate the IP67 rating.

8. Ensure that the cotter pin is visible from both sides of the assembly after fitting and is flush/sub flush with the insulator.
9. Screw the cable gland into the insulator, tightening to a torque of 11Nm maximum.
10. Finally inspect overall assembly.

Note for users of fine stranded cables

When using fine stranded power cables it is advisable to use the maximum number of sleeves and increase the torque setting. This will protect the individual cable strands from mechanical damage and allow greater compression of the conductor.

2.3 PANEL MOUNT TERMINATION

Panel receptacles are supplied fully assembled with contacts (See Figure 13 below.) An M12 nut and a spring washer are also supplied loosely fitted onto the contact. Termination to the panel connector is made by fitting the cable lug or other accessory using the nut and washer.

2.3.1 Panel Mount Connector Components

Shown below in figure 13 are the components supplied for both line drain and line source panel connectors. Both connector types include the following;

- Insulator Assembly (incorporating a fully fitted contact assembly).
- M12 Nut.
- M12 Washer.

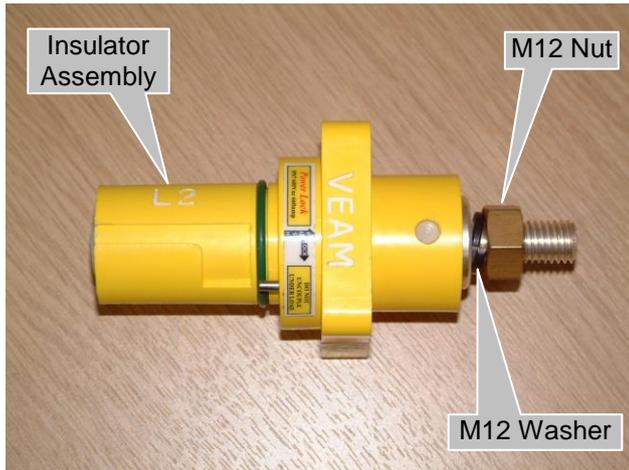


Figure 13. Panel Type Connector

2.3.2 Recommended Assembly Procedure

1. Remove the M12 nut and washer from the threaded post.
2. Fit terminal or accessory over the threaded post.
3. Refit the M12 washer and nut onto the threaded post and tighten to a maximum value of 12Nm.

3. TERMINATION TEST DATA

This data is shown in a separate test report (Report No. 1392) and shows details of the test data currently available. It is continually updated as new cables are tested. It shows the test results obtained for specific combinations of contact, cable, crimp tool and die.

Results for the following termination methods are shown:

- Crimp termination.
- Set screw termination.

4. HYDRAULIC CRIMP TOOL SUPPLIERS

Listed below are details of known suppliers of suitable crimp tools and dies. Other tools and dies may be suitable but if the customer is unsure that the crimped joint obtained meets their requirements, ITT should be contacted for advice.

ITT

Crimping Tool (Type Dubuis C130) - Part No. 000V74174

Crimping Tool and Die Set - Part No. 000V71400

Contact details shown below.

Kompress

Crimping Tool - Part No. KHH13C

Die Set - Part No. 13C

Contact details are as follows;

Kompress Holdings Ltd

Little Tennis Street

Nottingham NG2 4EL

United Kingdom

Tel: +44 (0) 115 958 1029

5. GENERAL

5.1 Maintenance

- a) Periodic greasing of the O-ring seal with Molytcote 3451 is recommended.
- b) Periodic inspection of the contacts should be carried out for damage and ensuring finger protection is in place.
- c) Periodic retention testing of PS (Power Source) contacts using ITT VEAM tool T4907 is recommended to confirm that contact life has not been exceeded.
- d) Ensure cotter pin is still in position.

5.2 Application

The Connector and wiring should be checked before making live, to have no damage to metal parts or insulators, loose strands, conducting lubricants, swarf or any other undesired conducting particles. Circuit resistance and continuity check should be made to make certain that there are no high resistance joints or spurious conducting paths. Always use the correct tools as specified in the data sheet/catalogue. Do not permit untrained personnel to wire, assemble or tamper with connectors. For operating voltage, please see appropriate national regulations.

5.3 Handling

Care must be taken to avoid damage to any component parts of electrical connectors during installation and use. Although there are normally no sharp edges, care must be taken when handling certain components to avoid injury to fingers.

- Protective caps should be used when not in use to prevent ingress of dirt or moisture. They are available in two forms:
 1. Dust caps rated at IP53.
 2. Environmental caps rated at IP67.Both caps also provide protection from physical damage.
- If connectors become contaminated, they should be dis-assembled for cleaning by removing the cotter pin. When re-assembling, a new cotter pin should be used to ensure water tightness.

6. DISCLOSURE STATEMENT

As there are many cables made to the same specification but with different measurements, it is advisable to contact your local sales office so they can advise the best possible crimping solution. There are also many crimping tools and crimping die combinations available and as such ITT Industries cannot be held responsible for defective crimps unless a sample of cable is submitted for confirmation testing.

7. CONTACT DETAILS

If any further assistance is required, please contact;

Germany	+49.7151.699.0
UK	+44.1256.311200
Italy	+39.2.93532.1
USA	+1.860.274.9681
Asia	+852.2732.2720

To enhance the level of information made available for this product range, this document along with all relevant information on the Powerlock range can be viewed on the ITT Industries website: <http://www.ittcannon.com/>

8. HOW TO ORDER

	Body Style	Line/Phase Colour	Contact Type	Cable Gland	Special Option
Example	NLDFT	E-GN	L	C240	M40B HG
Line Source	NLS				
Line Drain	NLDFT				
Panel Source	NPS				
Panel Drain	NPDFT				
Ground / Green	E-GN				
Neutral / Blue	N-BL				
Neutral / White	N-W				
Neutral / Black	N-BK				
Line 1 / Brown	1-BN				
Line 1 / Black	1-BK				
Line 1 / Red	1-R				
Line 2 / Black	2-BK				
Line 2 / Red	2-R				
Line 2 / White	2-W				
Line 3 / Grey	3-GY				
Line 3 / Blue	3-BL				
Use with NLDFT & NPDFT	L	NPDFT & NLDFT only			
Leave blank for NLS & NPS					
Crimp 300mm ² copper cable*	C300				
Crimp 240mm ² copper cable*	C240				
Crimp 185mm ² copper cable*	C185				
Crimp 150mm ² copper cable*	C150				
Crimp 120mm ² copper cable*	C120	NLS & NLDFT only			
Crimp 107mm ² copper cable*	C107				
Crimp 95mm ² copper cable*	C95				
Crimp 70mm ² copper cable*	C70				
Crimp 50mm ² copper cable*	C50				
Crimp 35mm ² copper cable*	C35				
Set Screw 120 mm ² (See Note)	S120				
M12 Threaded post 400amp	T4	NPS & NPDFT only			
M12 Threaded post 660amp	T6				
M12 Threaded hole 400amp	H4	NPS only			
M12 Threaded hole 660amp	H6				
Gland nut 15-23mm Ø	M40S				
Gland nut 19-28mm Ø	M40A	NLS & NLDFT only			
Gland nut 22-32mm Ø	M40B				
Gland nut 30-38mm Ø	M50				
Sliding Collar (Source only)	SC				
Hand Grip (Line only)	HG				
No Flange (Panel only)	NF				
M6 threaded insert front	M6F				
M6 threaded insert rear	M6R				

Release Key
Order Code -AN389900010

For Aluminium cable, please contact ITT Veam / Cannon or our local distributor.

WARNING

IMPORTANT SAFETY INFORMATION

Standard Powerlock and Snaplock contacts are copper based contacts, they should not be used for direct termination onto aluminium cables as galvanic corrosion and overheating can occur.

If you intend to use aluminium cables please contact ITT for advice on alternatives to the standard copper contacts.